


PRINCES PINE ROAD

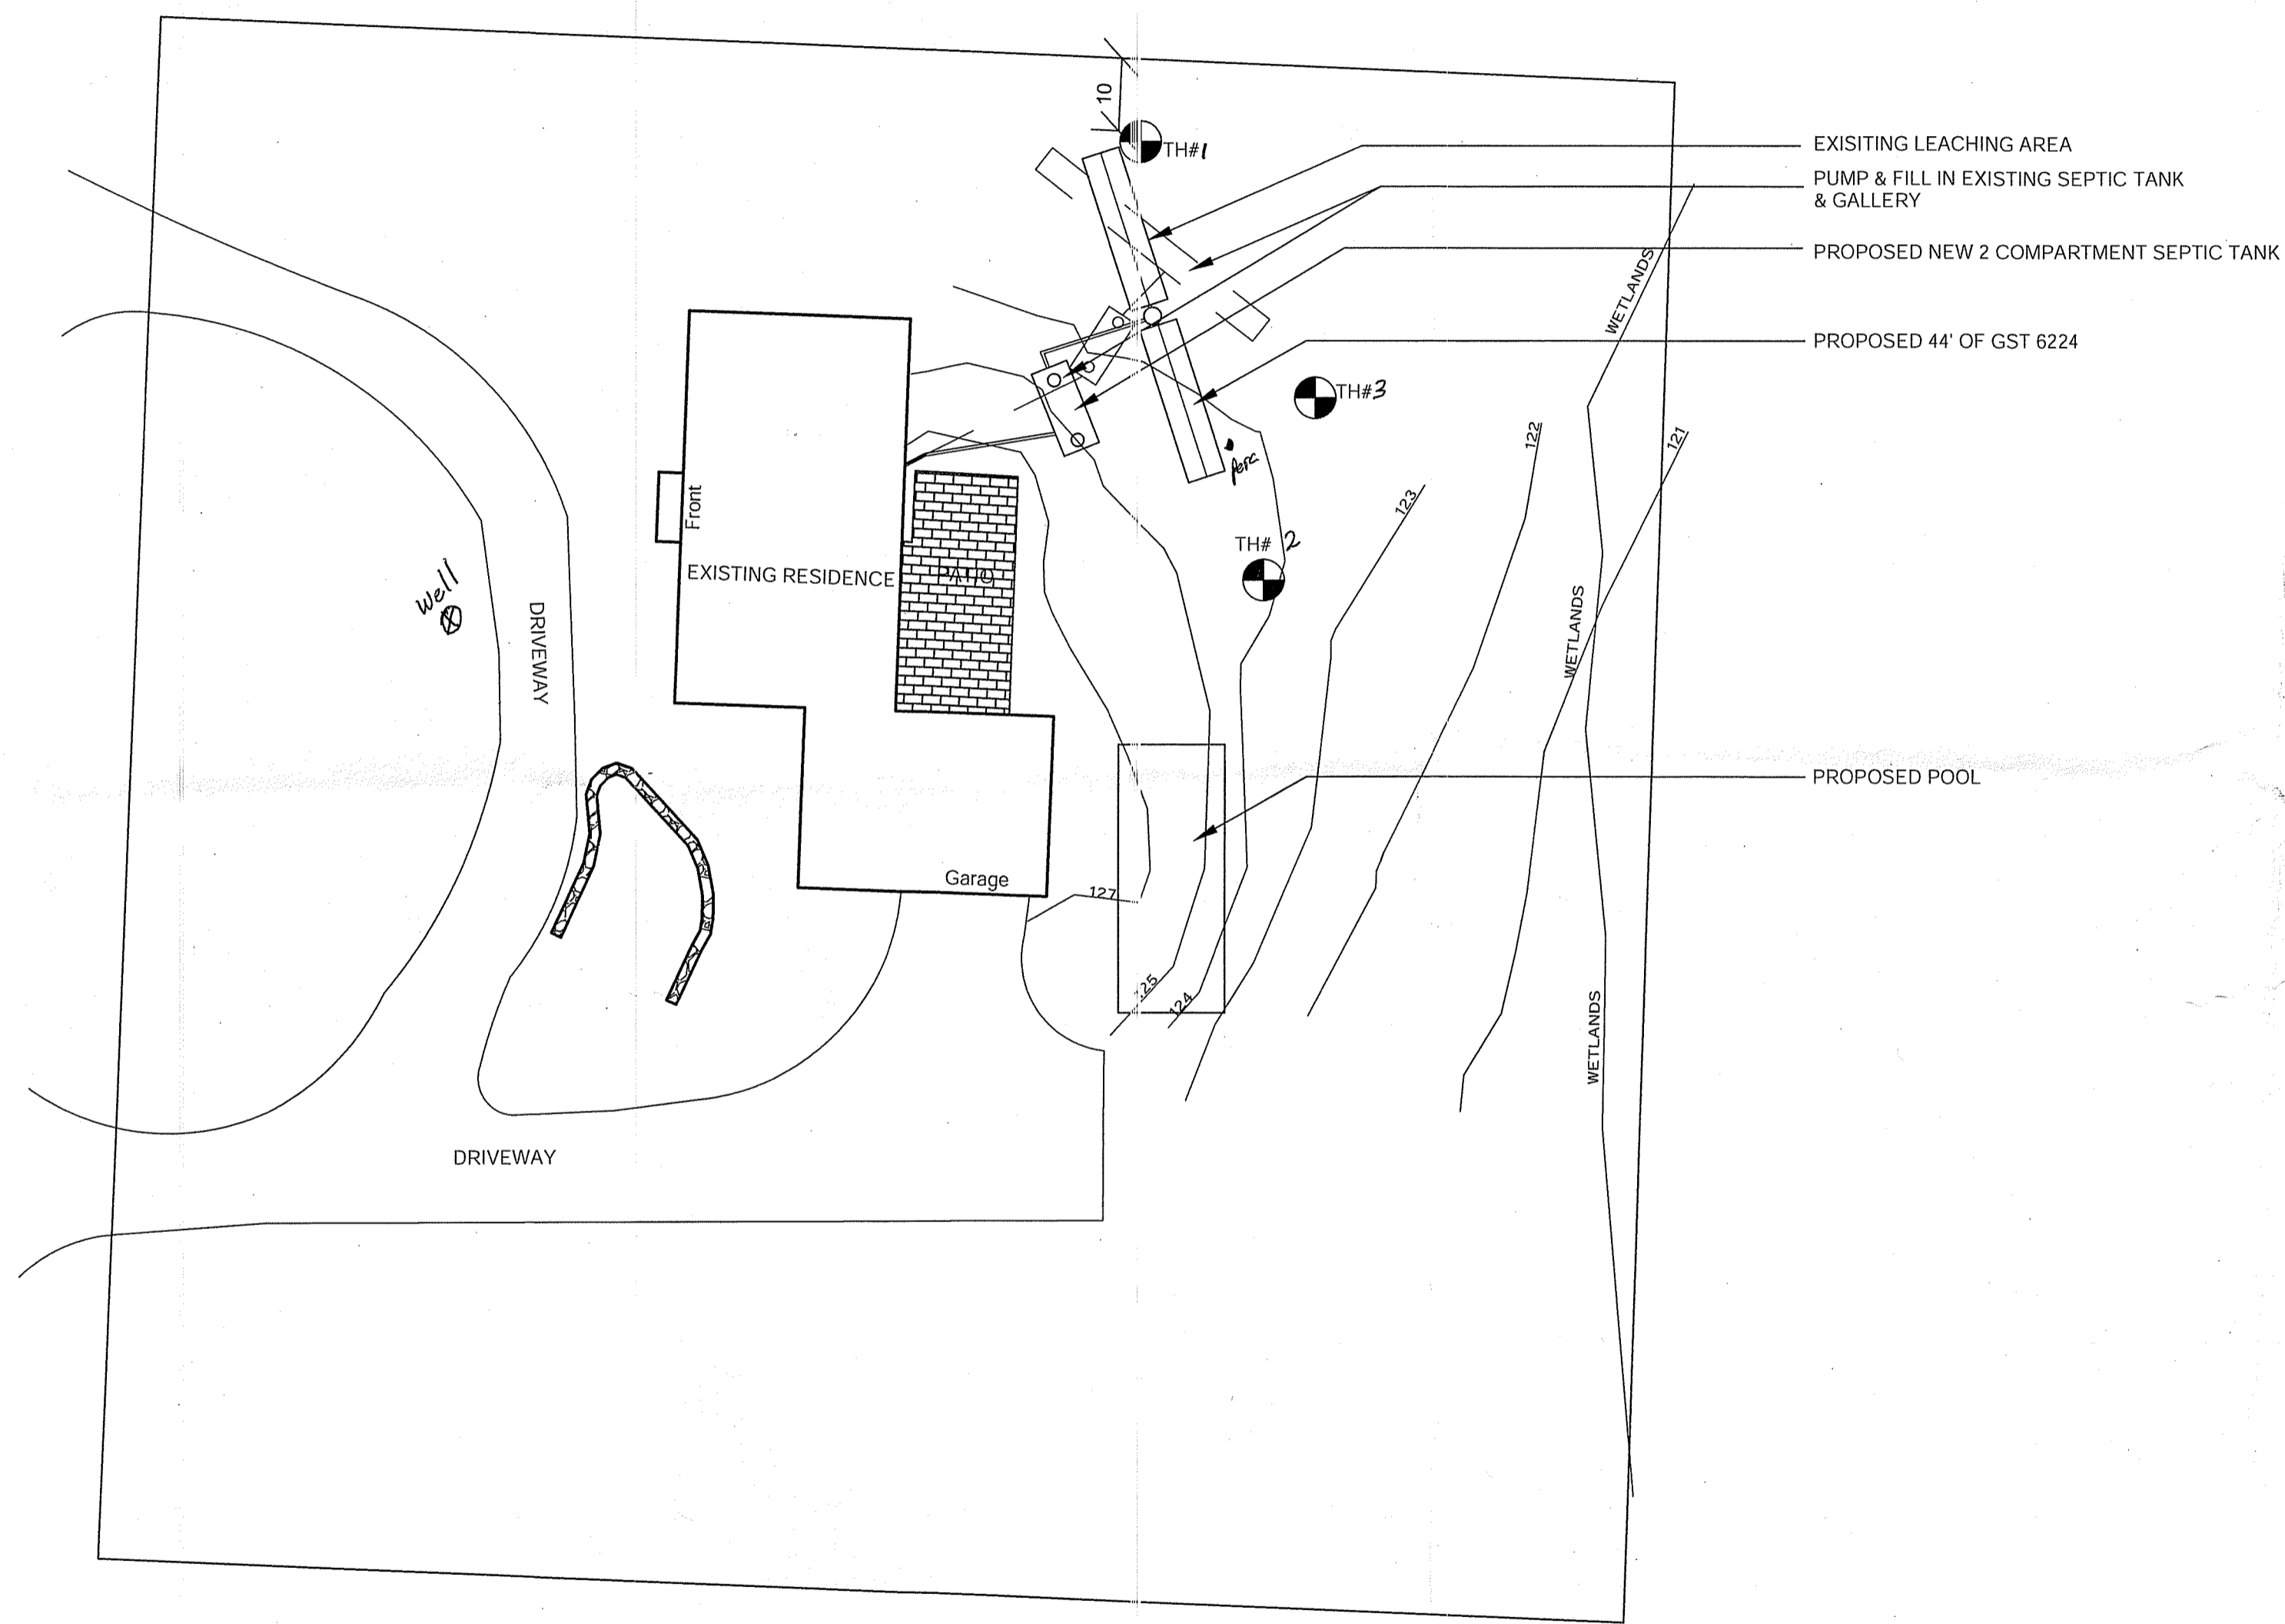

CODE COMPLYING AREA

4 BEDROOM DESIGN 1 1/20 Min. Perc.
 787.5 SQUARE FEET REQUIRED
 PROPOSED 44' OF GST 6224
 44' X 18.1 SQFT/LF = 796.4 SQ. FT. TOTAL
 MLSS.
 MLSS NOT REQUIRED

TEST HOLE DATA

TH#1		TH#2	
65" -	Total Depth	68" -	Total Depth
0" - 16"	Topsoil	0" - 16"	Topsoil
16" - 28"	Yellow/Brown Gravel	16" - 29"	Brown Gravel w/Fine Silty Loam
	Fine Silty Loam	64" -	Water
28" - 65"	Gravel Sand w/Cobbles	64" -	No Restrict Layer
	No Restrict Layer		

TH#3		PERC DATA	
69" -	Total Depth	8" ROUND / 17" DEEP	
0" - 9"	Fill/Cover	<u>TIME</u>	<u>DROP</u>
9" - 16"	Topsoil	2:30	3.50"
16" - 30"	Dark Brown Gravel	2:40	7.875"
	Fine Silty Loam w/Silt	2:50	10.00"
30" - 69"	Gravel, Sand w/Cobbles	3:00	11.625"
	No Restrict Layer	3:10	13.00"
		3:20	14.00"
		3:31	15.00"
		3:42	16.00"
		1/10 - 20 MIN. PERC.	

NOTE:
 1. THERE ARE NO WELLS OR SEPTIC SYSTEMS WITHIN 75' OF THE PROPOSED SEPTIC SYSTEM.
 2. FIGURED DIMENSIONS ARE TO BE TAKEN IN PREFERENCE TO SCALING.

**D. PALLADINO & SON
 SEPTIC CO. INC.**

P.O.BOX 968 NEW CANAAN CT 06840
 TEL: (203)966-9349
 LICENSE #004053

*KELLEY E. JOYCE &
 R. TAYLOR INGRAHAM
 42 PRINCES PINE ROAD
 NOWALK CT.*

DATE: 06/29/2021 DRAW. NO.
 SCALE: 1" = 20' - 0" **P1749**